



PROJECT:

BROCKHILL EAST, Phase 2

REDDITCH

DRAINAGE & FLOOD RISK STATEMENT

For

**PERSIMMON HOMES SOUTH MIDLANDS
AND GALLAGHER ESTATES**

July 2013

Our Ref: AAC 4835

RPS Planning & Development

Highfield House
5 Ridgeway
Quinton Business Park
Birmingham
B32 1AF

Tel: 0121 213 5500

Fax: 0121 213 5502

Email: rpsbham@rpsgroup.com

QUALITY MANAGEMENT

Prepared by:	ADAM GRANGER
Authorised by:	MARTIN PROBERT
Date:	31 July 2013
Project Number/Document Reference:	AAC4835

DISCLAIMER

The opinions and interpretations presented in this report represent our best technical interpretation of the data made available to us. However, due to the uncertainty inherent in the estimation of all parameters, we cannot, and do not guarantee the accuracy or correctness of any interpretation and we shall not, except in the case of gross or wilful negligence on our part, be liable or responsible for any loss, cost damages or expenses incurred or sustained by anyone resulting from any interpretation made by any of our officers, agents or employees.

Except for the provision of professional services on a fee basis, RPS does not have a commercial arrangement with any other person or company involved in the interests that are the subject of this report.

RPS cannot accept any liability for the correctness, applicability or validity for the information they have provided, or indeed for any consequential costs or losses in this regard. Our efforts have been made on a "best endeavours" basis and no responsibility or liability is warranted or accepted by RPS.

COPYRIGHT © RPS

The material presented in this report is confidential. This report has been prepared for the exclusive use of Persimmon Homes South Midlands / Gallagher Estates and shall not be distributed or made available to any other company or person without the knowledge and written consent of Persimmon Homes South Midlands / Gallagher Estates or RPS.

1 INTRODUCTION

1.1 PURPOSE OF REPORT

- This report considers the flood risk associated with the development of a parcel of greenfield land known as Brockhill East, Phase 2 on the northern outskirts of Redditch. The southern portion of the land falls within the Redditch Borough Council boundary with the northern portion being within Bromsgrove District Council's boundary.
- This report also sets out the proposed foul and surface water drainage strategy for the proposed development.

1.2 SITE DETAILS


- The site bounds the Birmingham to Redditch railway line to the east, Weights Lane to the north and an industrial development off Winsor Road to the south.
- Development by Persimmon Homes of a parcel of land known as Brockhill East Phase 1, located immediately to the south of Brockhill East Phase 2 is currently underway.
- An indicative masterplan for Brockhill East Phase 2 can be found in appendix A of this report. This also shows the phase 1 development.
- The phase 2 development parcel occupies approx 83 hectares, and the development proposals include residential parcels, a mixed use local centre and employment parcels. There are also extensive areas of public open space/amenity space including tree and woodland planting, as well as a network of surface water features which will provide a sustainable means of surface water run-off control.
- The approximate proposed impermeable area of the site is estimated to be 30% of the site area, this equates to 24.9 hectares (this includes highway infrastructure, roofs, hard standings, driveways and car parks etc).
- The Red Ditch flows through the site in a south easterly direction before turning to follow a north easterly route alongside but outside of the south eastern boundary of the site. It then turns again to flow in a south easterly direction adjacent to the railway boundary before passing beneath Windsor Road.
- The site is relatively steeply sloping and falls within the catchment of the Red Ditch.

2 FLOOD RISK

2.1 NATURE OF FLOOD RISK

- The Environment Agency is responsible for the provision of information pertaining to flood risk from tidal and main watercourses throughout England and Wales. The EA provides an online information service through its Flood Map data an extract of which is provided in Figure 1.1 below. The site is wholly in flood zone 1 and therefore not prone to flooding from main watercourses.
- The Red Ditch is not classified as a main watercourse therefore Clive Wilson, Redditch Borough Council's Operations Manager – Asset Maintenance has indicated that there may be a requirement to hydraulically model the Red Ditch in order to determine the extent of any flood zone associated with it. This modelling work would be undertaken and included within a Flood Risk Assessment for the site at the formal planning application stage. Suitable hydraulic modelling was undertaken and approved as part of the planning submission for phase 1, the hydraulic model used for this will be extended as required to fully assess any flood issues that may affect the phase 2 development. It is however thought that due to the steeply sloping nature of the phase 2 site any flooding would be contained within a very narrow corridor along the Red Ditch. Any proposed development would be kept well outside of any areas of potential flooding.
- Surface Water run-off from the impermeable areas of the proposed development will discharge at existing greenfield run off rates to the Red Ditch. Appropriate surface water detention facilities such as ponds and swales will be provided throughout the development to sufficiently accommodate flows arising from storms up to a 1 in 100 year event plus a 30% allowance for future climate change. As a consequence of the development flows within the development and downstream would be better regulated reducing the risk of flooding to properties to the south and east.
- The surface water drainage will fully comply with the requirements of the Land Drainage Act, the Flood Water Management Act, Severn Trent Water, Redditch Borough Council and Bromsgrove District Council.

Figure 1.1: Extract from EA Flood Map (downloaded on 30.07.2013)

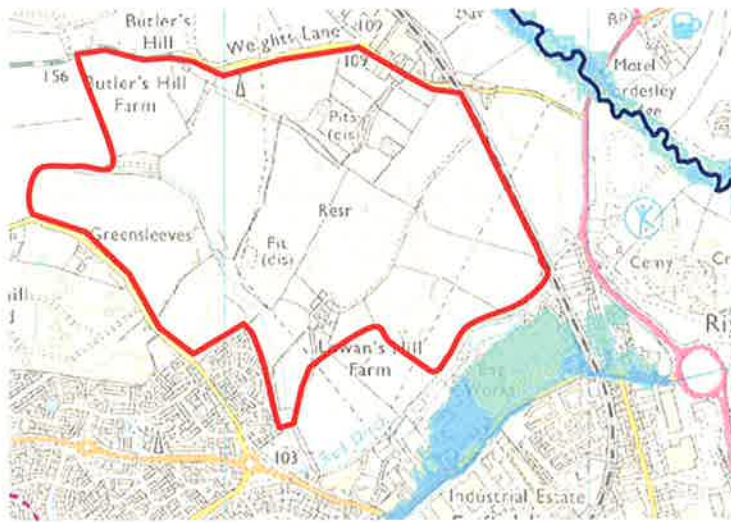

- Flooding from rivers or sea without defences (1 in 100yr)
- Extent of extreme flood (1 in 1000yr)
- Flood defences
- Areas benefiting from flood defences

Based upon the Ordnance Survey map with the Permission of the Controller of Her Majesty's Stationery Office. © Crown copyright Licence No. 100020449 RPS Design Group Ltd

3 SURFACE WATER DRAINAGE

3.1 SURFACE WATER DRAINAGE STRATEGY

- Surface water drainage within the development site will be designed to accommodate flows arising from storms up to a 1 in 100 year event plus a 30% allowance for future climate change without any surface flooding or risk to lower lying properties.
- Flows should be limited to existing greenfield run off rates and discharge to the Red Ditch which runs through and outside the site.
- The greenfield run off rates have been calculated using Microdrainage software: ICP SUDS Mean Annual Flood, the results of which are as follows:

Impermeable area	24.9 hectares
Qbar run-off rate	109.4 litres/second
1 in 100 year run-off rate	281.1 litres/second

The results are contained in appendix B.

- Surface Water detention volumes have been calculated again using Microdrainage software, the results of which are as follows:

Impermeable Area	24.9 hectares
Detention Volume, for Qbar Outflow	16882.7m ³
Detention Volume, for 1 in 100 year Outflow	13410.3m ³

The results are contained in appendix C.

- The proposed surface water detention ponds shown on the masterplan contained in appendix A are of sufficient size to accommodate the flows arising from a 1 in 100 year storm plus a 30% allowance for future climate change, with an outflow no greater than the Qbar run off rate.
- The drainage proposals are subject to detailed design, following completion of a detailed development plan. At that time the actual impermeable areas will be utilised and the greenfield run-off rate re-calculated as necessary.
- The use of infiltration methods as means of surface water disposal will also be investigated following the undertaking of ground investigation works, however from the results obtained for phase 1 it is unlikely that such methods will be viable.

- The proposed detention ponds and other surface water features will be designed to provide sufficient treatment trains for surface water quality improvements, permanently wet ponds with reed beds and other natural features will be provided in the ponds which as well as improving water quality will also have amenity value and help to increase and enhance biodiversity etc.

4 FOUL WATER DRAINAGE

4.1 FOUL WATER DRAINAGE STRATEGY

- Severn Trent Water were commissioned by Persimmon Homes South Midlands to carry out various hydraulic modelling assessments of the foul water sewer network in the vicinity of the site to establish whether available capacity is available to accommodate foul water flows from the development.
- From the results of the modelling it was established that there was sufficient capacity to accommodate flows from phase 1 of the development within the foul water sewer infrastructure to the south of the site (Windsor Road), however it was identified that there would not be sufficient capacity within the immediate vicinity of the site to accommodate the foul flows arising from Phase 2 without the risk of flooding.
- Severn Trent Water have therefore advised that foul water from the Phase 2 development site would need to gravitate to a single new foul water pumping station, flows would then be pumped over the River Arrow and gravitate via a new trunk sewer through the Arrow Valley or around the outskirts of Redditch before outfalling to the existing public sewer system downstream of Ipsley Church Lane (where sufficient capacity exists) before finally discharging to the Sperrall Sewage Treatment Works.
- This would provide a suitable and sustainable outfall.
- This solution would not exacerbate any existing flooding problems, and the new trunk sewer could be utilised to convey flows from other adjacent areas where flooding may be occurring thus improving capacities and alleviating occurrences of flooding.
- Severn Trent Water cannot refuse a sewer connection on capacity grounds, and as such they are obliged to upgrade the existing sewer system as necessary sufficient to accommodate new development flows (at their expense). They are required to carry out the improvement works within a reasonable time, which for major improvement works could be a number of years. Bearing this in mind the developer is continuing to discuss the development proposals with Severn Trent Water to ensure that the development will be deliverable and improvement works are completed at the necessary time.

5 CONCLUSIONS

5.1 FLOOD RISK

- As demonstrated in section 2 of this report, the site is not at risk of flooding from main watercourses and is located in flood zone 1
- Hydraulic modelling will be carried out to establish whether there is any potential flooding from the Red Ditch; no development would be carried out in any such areas.
- Surface water outflow from the site will be limited to existing greenfield run off rates, and suitable on site surface water detention facilities provided. As a consequence there will be no increase risk of flooding to the site or lower lying land outside the development site.
- In conclusion for the aforementioned reasons the proposed development would not increase flood risk.

5.2 SURFACE WATER DRAINAGE

- As demonstrated in section 3 of this report, a suitable surface water drainage solution can be provided with outflows at greenfield run-off rates to the Red Ditch.
- Sufficient space is provided on the current masterplan to accommodate the required surface water detention features.
- In conclusion for the aforementioned reasons a suitable and sustainable surface water drainage solution for proposed development is deliverable.

5.3 FOUL WATER DRAINAGE

- As demonstrated in section 4 of this report, a suitable foul water drainage solution can be provided in accordance with the requirements of Severn Trent Water.

- Some off site improvement works are required, all of which are deliverable and may have benefits to areas downstream where capacity problems exist and flooding occurs.
- In conclusion for the aforementioned reasons a suitable and sustainable foul water drainage solution for proposed development is deliverable.

5.4 ADDITIONAL REQUIREMENTS FOR FORMAL PLANNING APPLICATION IN RESPECT OF FLOOD RISK AND DRAINAGE

- Hydraulic Modelling of Red Ditch.
- Preparation of Flood Risk Assessment.
- Further dialogue and agreement with Redditch Borough Councils Land Drainage Officer.
- Further dialogue and agreement with Severn Trent Water with regard to the provision of foul water drainage outfall.
- Further preliminary but more detailed designs of surface water infrastructure and surface water detention facilities.
- Completion of detailed foul and surface water drainage strategy.

A. APPENDIX A

Drawing No. AAH4936-121-A Phase 2 Masterplan

Brockhill East, Redditch

Phase 2 Masterplan Redditch/Bromsgrove-I:2500@A1-17.05.13-AG

Rev A - Updated following LA Meeting. 02.07.13. PJB.



This drawing and the building works depicted are the copyright of RPS Planning & Development Ltd and may not be reproduced or amended except by written permission. No liability will be accepted for amendments made by other persons.

The Contractor is to check and verify all building and site dimensions, levels and sewer invert levels at connection points before work starts. The Contractor is to comply in all respects with current Building Legislation, British Standard Specifications, Building Regulations, Construction (Design & Management) Regulations, Party Wall Act, etc. whether or not specifically stated on this drawing. This drawing must be read with and checked against any structural, geotechnical or other specialist documentation provided.

This drawing is not intended to show details of foundations, ground conditions or ground contaminants. Each area of ground relied upon to support any structure depicted (including drainage) must be investigated by the Contractor. A suitable method of foundation should be provided allowing for existing ground conditions. Any suspect or fluid ground, contaminants on or within the ground, should be further investigated by a suitable expert. Any earthwork constructions shown indicate typical slopes for guidance only & should be further investigated by a suitable expert.

Where existing trees are to be retained they should be subject to a full Arboricultural Inspection for safety. All trees are to be planted so as to ensure they are a minimum of 5 metres from buildings and 3 metres from drainage and sewers. A suitable method of foundation is to be provided to accommodate the proposed tree planting.

Sketch proposals are for illustrative purposes only & as such are subject to detailed site investigation including ground conditions/contaminants, drainage, design & planning/density negotiations. Sketch proposals may be based upon engagements of OS sheets & visual estimations of existing site features, accuracy will therefore need to be verified by survey. Sketch proposals have not been considered in respect of CDPA Regulations.



- Key**
- Proposed Residential Parcels
 - Existing Trees & Hedgerows
 - Proposed Woodland Planting
 - Proposed Tree Planting
 - Mixed Use Local Centre (with indicative gateway frontage)
 - Employment (with indicative gateway frontage)
 - Public Open Space / Amenity Space
 - Indicative Drainage Basin / Existing Water Feature
 - Main Street / Main Internal Loop Road
 - Shared Surface Spaces / Local Streets
 - Lowan's Hill Farm (proposed conversion)
 - Vehicle Access Points
 - Phase I Site Boundary


AAH4936-12I-Rev A.



RPS Planning & Development Ltd.
Highfield House, 5 Ridgeway, Quinton Business Park, Birmingham, B12 1AF
T 0121 2135500 F 0121 2135502 E rpsbm@rpsgroup.com W www.rpsgroup.com

B. APPENDIX B

Greenfield run-off calculations

RPS Group Plc		Page 1
Highfield House 5 Ridgeway Quinton Business Park Birmingham B32 1AF	Brockhill East, Phase 2 Redditch Greenfield Run-off Rate	
Date 30.07.2013 File	Designed by A Granger Checked by	
Micro Drainage	Source Control 2013.1.1	

ICP SUDS Mean Annual Flood

Input

Return Period (years) 100 SAAR (mm) 700 Urban 0.000
Area (ha) 24.900 Soil 0.450 Region Number Region 4

Results 1/s

QBAR Rural 109.4
QBAR Urban 109.4


Q100 years 281.1

Q1 year 90.8
Q30 years 214.3
Q100 years 281.1

C. APPENDIX C


Surface Water Detention Volumes:

1. \bar{Q} outflow rate
2. 1 in 100 year outflow rate

RPS Group Plc		Page 1
Highfield House 5 Ridgeway Quinton Business Park Birmingham B32 1AF	Brockhill East, Phase 2 Surface Water Attenuation 109.4l/sec outflow Qbar	
Date 30 July 2013 File East Qbar.srcx	Designed by A Granger Checked by	
Micro Drainage	Source Control 2013.1.1	


Summary of Results for 100 year Return Period (+30%)

Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Volume (m³)	Status
15 min Summer	98.344	0.344	50.7	5779.5	O K
30 min Summer	98.450	0.450	65.7	7564.6	O K
60 min Summer	98.560	0.560	79.0	9401.7	O K
120 min Summer	98.668	0.668	89.4	11220.7	O K
180 min Summer	98.727	0.727	93.7	12217.5	O K
240 min Summer	98.765	0.765	96.1	12855.8	O K
360 min Summer	98.812	0.812	98.9	13648.1	O K
480 min Summer	98.842	0.842	100.6	14147.5	O K
600 min Summer	98.861	0.861	101.7	14459.4	O K
720 min Summer	98.872	0.872	102.3	14649.1	O K
960 min Summer	98.880	0.880	102.8	14791.9	O K
1440 min Summer	98.882	0.882	102.9	14816.7	O K
2160 min Summer	98.875	0.875	102.5	14705.0	O K
2880 min Summer	98.861	0.861	101.7	14463.1	O K
4320 min Summer	98.821	0.821	99.4	13788.4	O K
5760 min Summer	98.776	0.776	96.7	13035.3	O K
7200 min Summer	98.732	0.732	94.0	12296.6	O K
8640 min Summer	98.691	0.691	91.2	11611.5	O K
10080 min Summer	98.654	0.654	88.2	10989.8	O K
15 min Winter	98.385	0.385	56.7	6473.0	O K
30 min Winter	98.504	0.504	72.6	8474.5	O K
60 min Winter	98.627	0.627	85.8	10537.2	O K
120 min Winter	98.749	0.749	95.1	12588.9	O K
180 min Winter	98.817	0.817	99.2	13721.2	O K
240 min Winter	98.860	0.860	101.7	14452.0	O K
360 min Winter	98.915	0.915	104.7	15369.1	O K
480 min Winter	98.950	0.950	106.5	15958.5	O K
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Time-Peak (mins)	
15 min Summer	124.774	0.0	3017.7	31	
30 min Summer	81.962	0.0	3996.9	45	
60 min Summer	51.304	0.0	7332.3	74	
120 min Summer	31.039	0.0	8841.3	134	
180 min Summer	22.830	0.0	9691.4	192	
240 min Summer	18.253	0.0	10257.2	252	
360 min Summer	13.251	0.0	11004.2	368	
480 min Summer	10.562	0.0	11513.8	486	
600 min Summer	8.851	0.0	11869.8	606	
720 min Summer	7.658	0.0	12122.0	724	
960 min Summer	6.089	0.0	12413.4	958	
1440 min Summer	4.401	0.0	12453.9	1166	
2160 min Summer	3.176	0.0	19124.9	1544	
2880 min Summer	2.517	0.0	19731.7	1956	
4320 min Summer	1.811	0.0	19821.9	2772	
5760 min Summer	1.433	0.0	25140.7	3576	
7200 min Summer	1.194	0.0	25985.1	4392	
8640 min Summer	1.028	0.0	26515.4	5112	
10080 min Summer	0.906	0.0	26654.5	5944	
15 min Winter	124.774	0.0	3400.7	30	
30 min Winter	81.962	0.0	4481.4	45	
60 min Winter	51.304	0.0	8222.0	74	
120 min Winter	31.039	0.0	9877.8	132	
180 min Winter	22.830	0.0	10798.6	188	
240 min Winter	18.253	0.0	11406.0	246	
360 min Winter	13.251	0.0	12197.9	362	
480 min Winter	10.562	0.0	12728.5	478	

RPS Group Plc		Page 2
Highfield House 5 Ridgeway Quinton Business Park Birmingham B32 1AF	Brockhill East, Phase 2 Surface Water Attenuation 109.4l/sec outflow Qbar	
Date 30 July 2013 File East Qbar.srcx	Designed by A Granger Checked by	
Micro Drainage	Source Control 2013.1.1	

Summary of Results for 100 year Return Period (+30%)

Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Volume (m³)	Status
600 min Winter	98.973	0.973	107.7	16339.2	O K
720 min Winter	98.987	0.987	108.4	16585.3	O K
960 min Winter	99.001	1.001	109.1	16822.7	O K
1440 min Winter	98.998	0.998	108.9	16759.1	O K
2160 min Winter	98.981	0.981	108.1	16489.0	O K
2880 min Winter	98.955	0.955	106.8	16047.4	O K
4320 min Winter	98.889	0.889	103.2	14928.9	O K
5760 min Winter	98.820	0.820	99.3	13767.7	O K
7200 min Winter	98.755	0.755	95.4	12683.7	O K
8640 min Winter	98.697	0.697	91.6	11716.2	O K
10080 min Winter	98.647	0.647	87.6	10872.3	O K
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Time-Peak (mins)	
600 min Winter	8.851	0.0	13090.4	592	
720 min Winter	7.658	0.0	13339.0	706	
960 min Winter	6.089	0.0	13604.5	926	
1440 min Winter	4.401	0.0	13554.3	1328	
2160 min Winter	3.176	0.0	21323.7	1648	
2880 min Winter	2.517	0.0	21955.1	2108	
4320 min Winter	1.811	0.0	21941.6	2992	
5760 min Winter	1.433	0.0	28162.6	3856	
7200 min Winter	1.194	0.0	29110.9	4680	
8640 min Winter	1.028	0.0	29709.8	5448	
10080 min Winter	0.906	0.0	29873.4	6248	

RPS Group Plc		Page 3
Highfield House 5 Ridgeway Quinton Business Park Birmingham B32 1AF	Brockhill East, Phase 2 Surface Water Attenuation 109.4l/sec outflow Qbar	
Date 30 July 2013 File East Qbar.srcx	Designed by A Granger Checked by	
Micro Drainage	Source Control 2013.1.1	


Rainfall Details

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	100	Cv (Summer)	0.750
Region	England and Wales	Cv (Winter)	0.840
M5-60 (mm)	19.500	Shortest Storm (mins)	15
Ratio R	0.400	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+30

Time Area Diagram

Total Area (ha) 24.900

Time (mins)	Area	Time (mins)	Area	Time (mins)	Area	Time (mins)	Area
From: To: (ha)		From: To: (ha)		From: To: (ha)		From: To: (ha)	
0 4	6.225	4 8	6.225	8 12	6.225	12 16	6.225

RPS Group Plc		Page 4
Highfield House 5 Ridgeway Quinton Business Park Birmingham B32 1AF	Brockhill East, Phase 2 Surface Water Attenuation 109.4l/sec outflow Qbar	
Date 30 July 2013 File East Qbar.srcx	Designed by A Granger Checked by	
Micro Drainage	Source Control 2013.1.1	

Model Details

Storage is Online Cover Level (m) 100.000

Tank or Pond Structure


Invert Level (m) 98.000

Depth (m)	Area (m ²)	Depth (m)	Area (m ²)	Depth (m)	Area (m ²)	Depth (m)	Area (m ²)	Depth (m)	Area (m ²)
0.000	16800.0	0.600	16800.0	1.200	16800.0	1.800	16800.0	2.400	16800.0
0.100	16800.0	0.700	16800.0	1.300	16800.0	1.900	16800.0	2.500	16800.0
0.200	16800.0	0.800	16800.0	1.400	16800.0	2.000	16800.0		
0.300	16800.0	0.900	16800.0	1.500	16800.0	2.100	16800.0		
0.400	16800.0	1.000	16800.0	1.600	16800.0	2.200	16800.0		
0.500	16800.0	1.100	16800.0	1.700	16800.0	2.300	16800.0		

Hydro-Brake® Outflow Control


Design Head (m) 1.000 Hydro-Brake® Type Md8 Invert Level (m) 98.000
Design Flow (l/s) 109.4 Diameter (mm) 412

Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)
0.100	12.6	0.800	98.2	2.000	148.5	4.000	207.9	7.000	275.0
0.200	28.2	1.000	109.0	2.200	155.3	4.500	220.5	7.500	284.6
0.300	44.0	1.200	118.2	2.400	161.9	5.000	232.4	8.000	294.0
0.400	58.8	1.400	126.5	2.600	168.2	5.500	243.7	8.500	303.0
0.500	72.1	1.600	134.2	3.000	180.4	6.000	254.6	9.000	311.8
0.600	83.2	1.800	141.5	3.500	194.6	6.500	265.0	9.500	320.3

RPS Group Plc		Page 1
Highfield House 5 Ridgeway Quinton Business Park Birmingham B32 1AF	Brockhill East, Phase 2 Surface Water Attenuation 281.1l/sec outflow	
Date 30 July 2013 File East 1 in 100.srcx	Designed by A Granger Checked by	
Micro Drainage	Source Control 2013.1.1	


Summary of Results for 100 year Return Period (+30%)

Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Volume (m³)	Status
15 min Summer	98.426	0.426	126.7	5714.8	O K
30 min Summer	98.555	0.555	167.1	7435.5	O K
60 min Summer	98.682	0.682	204.5	9136.3	O K
120 min Summer	98.795	0.795	234.9	10657.6	O K
180 min Summer	98.846	0.846	247.5	11342.7	O K
240 min Summer	98.870	0.870	253.2	11664.3	O K
360 min Summer	98.884	0.884	256.5	11848.3	O K
480 min Summer	98.891	0.891	258.0	11936.9	O K
600 min Summer	98.893	0.893	258.5	11970.8	O K
720 min Summer	98.893	0.893	258.4	11965.6	O K
960 min Summer	98.885	0.885	256.7	11863.4	O K
1440 min Summer	98.856	0.856	249.8	11471.8	O K
2160 min Summer	98.802	0.802	236.6	10744.5	O K
2880 min Summer	98.749	0.749	222.8	10033.0	O K
4320 min Summer	98.659	0.659	197.9	8829.4	O K
5760 min Summer	98.590	0.590	177.7	7902.7	O K
7200 min Summer	98.535	0.535	161.1	7176.2	O K
8640 min Summer	98.491	0.491	147.4	6586.9	O K
10080 min Summer	98.456	0.456	136.2	6110.5	O K
15 min Winter	98.478	0.478	143.1	6400.5	O K
30 min Winter	98.622	0.622	187.2	8331.7	O K
60 min Winter	98.765	0.765	227.0	10246.4	O K
120 min Winter	98.894	0.894	258.6	11977.9	O K
180 min Winter	98.953	0.953	271.6	12773.8	O K
240 min Winter	98.982	0.982	277.5	13164.9	O K
360 min Winter	99.001	1.001	281.1	13414.8	O K
480 min Winter	99.001	1.001	281.1	13410.3	O K
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Time-Peak (mins)	
15 min Summer	124.774	0.0	4728.7	30	
30 min Summer	81.962	0.0	6292.3	44	
60 min Summer	51.304	0.0	9152.8	72	
120 min Summer	31.039	0.0	11099.2	130	
180 min Summer	22.830	0.0	12250.9	186	
240 min Summer	18.253	0.0	13056.9	244	
360 min Summer	13.251	0.0	14201.3	330	
480 min Summer	10.562	0.0	15066.1	386	
600 min Summer	8.851	0.0	15748.8	448	
720 min Summer	7.658	0.0	16310.1	514	
960 min Summer	6.089	0.0	17188.0	650	
1440 min Summer	4.401	0.0	18323.5	924	
2160 min Summer	3.176	0.0	21162.7	1328	
2880 min Summer	2.517	0.0	22297.2	1716	
4320 min Summer	1.811	0.0	23740.0	2476	
5760 min Summer	1.433	0.0	25651.2	3232	
7200 min Summer	1.194	0.0	26691.1	3968	
8640 min Summer	1.028	0.0	27521.0	4680	
10080 min Summer	0.906	0.0	28113.3	5448	
15 min Winter	124.774	0.0	5329.9	30	
30 min Winter	81.962	0.0	7084.2	44	
60 min Winter	51.304	0.0	10271.9	72	
120 min Winter	31.039	0.0	12452.9	128	
180 min Winter	22.830	0.0	13743.0	182	
240 min Winter	18.253	0.0	14645.9	238	
360 min Winter	13.251	0.0	15927.8	348	
480 min Winter	10.562	0.0	16896.5	402	

RPS Group Plc		Page 2
Highfield House 5 Ridgeway Quinton Business Park Birmingham B32 1AF	Brockhill East, Phase 2 Surface Water Attenuation 281.1l/sec outflow	
Date 30 July 2013 File East 1 in 100.srcx	Designed by A Granger Checked by	
Micro Drainage	Source Control 2013.1.1	

Summary of Results for 100 year Return Period (+30%)

Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Volume (m³)	Status
600 min Winter	99.000	1.000	281.0	13408.3	O K
720 min Winter	98.995	0.995	280.0	13340.3	O K
960 min Winter	98.976	0.976	276.2	13078.3	O K
1440 min Winter	98.921	0.921	264.8	12347.9	O K
2160 min Winter	98.835	0.835	244.9	11197.3	O K
2880 min Winter	98.759	0.759	225.6	10175.5	O K
4320 min Winter	98.640	0.640	192.6	8577.4	O K
5760 min Winter	98.554	0.554	166.9	7426.2	O K
7200 min Winter	98.490	0.490	147.1	6571.1	O K
8640 min Winter	98.441	0.441	131.5	5911.1	O K
10080 min Winter	98.402	0.402	118.8	5385.8	O K
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Time-Peak (mins)	
600 min Winter	8.851	0.0	17661.3	472	
720 min Winter	7.658	0.0	18290.3	548	
960 min Winter	6.089	0.0	19274.2	700	
1440 min Winter	4.401	0.0	20546.7	994	
2160 min Winter	3.176	0.0	23713.5	1412	
2880 min Winter	2.517	0.0	24987.9	1820	
4320 min Winter	1.811	0.0	26619.5	2600	
5760 min Winter	1.433	0.0	28732.7	3352	
7200 min Winter	1.194	0.0	29900.6	4112	
8640 min Winter	1.028	0.0	30838.0	4848	
10080 min Winter	0.906	0.0	31527.0	5560	

RPS Group Plc		Page 3
Highfield House 5 Ridgeway Quinton Business Park Birmingham B32 1AF	Brockhill East, Phase 2 Surface Water Attenuation 281.1l/sec outflow	
Date 30 July 2013 File East 1 in 100.srcx	Designed by A Granger Checked by	
Micro Drainage	Source Control 2013.1.1	


Rainfall Details

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	100	Cv (Summer)	0.750
Region	England and Wales	Cv (Winter)	0.840
M5-60 (mm)	19.500	Shortest Storm (mins)	15
Ratio R	0.400	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+30

Time Area Diagram

Total Area (ha) 24.900

Time (mins)	Area	Time (mins)	Area	Time (mins)	Area	Time (mins)	Area
From:	To:	From:	To:	From:	To:	From:	To:
	(ha)		(ha)		(ha)		(ha)
0	4 6.225	4	8 6.225	8	12 6.225	12	16 6.225

RPS Group Plc		Page 4
Highfield House 5 Ridgeway Quinton Business Park Birmingham B32 1AF	Brockhill East, Phase 2 Surface Water Attenuation 281.1l/sec outflow	
Date 30 July 2013 File East 1 in 100.srcx	Designed by A Granger Checked by	
Micro Drainage	Source Control 2013.1.1	

Model Details

Storage is Online Cover Level (m) 100.000

Tank or Pond Structure

Invert Level (m) 98.000

Depth (m)	Area (m²)	Depth (m)	Area (m²)	Depth (m)	Area (m²)	Depth (m)	Area (m²)	Depth (m)	Area (m²)
0.000	13402.0	0.600	13402.0	1.200	13402.0	1.800	13402.0	2.400	13402.0
0.100	13402.0	0.700	13402.0	1.300	13402.0	1.900	13402.0	2.500	13402.0
0.200	13402.0	0.800	13402.0	1.400	13402.0	2.000	13402.0		
0.300	13402.0	0.900	13402.0	1.500	13402.0	2.100	13402.0		
0.400	13402.0	1.000	13402.0	1.600	13402.0	2.200	13402.0		
0.500	13402.0	1.100	13402.0	1.700	13402.0	2.300	13402.0		

Hydro-Brake® Outflow Control

Design Head (m) 1.000 Hydro-Brake® Type Md8 Invert Level (m) 98.000
Design Flow (l/s) 281.1 Diameter (mm) 664

Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)
0.100	23.4	0.800	236.1	2.000	395.6	4.000	542.4	7.000	714.4
0.200	53.6	1.000	281.0	2.200	412.4	4.500	574.2	7.500	739.4
0.300	85.8	1.200	312.5	2.400	428.5	5.000	604.6	8.000	763.6
0.400	118.3	1.400	336.8	2.600	444.0	5.500	633.7	8.500	787.1
0.500	150.1	1.600	358.3	3.000	473.7	6.000	661.6	9.000	809.9
0.600	180.7	1.800	377.7	3.500	509.0	6.500	688.5	9.500	832.1